


Black Hills Energy Colorado Electric Level 2 Review Typical Hookup Diagram for Interconnection of Renewable Energy Systems Greater than 10KW

Customer Information: Name _____ Phone # _____ Account # _____

Address/Location/Sec/Twn/Rng of Renewable Energy System _____

Nearest Street Intersection _____

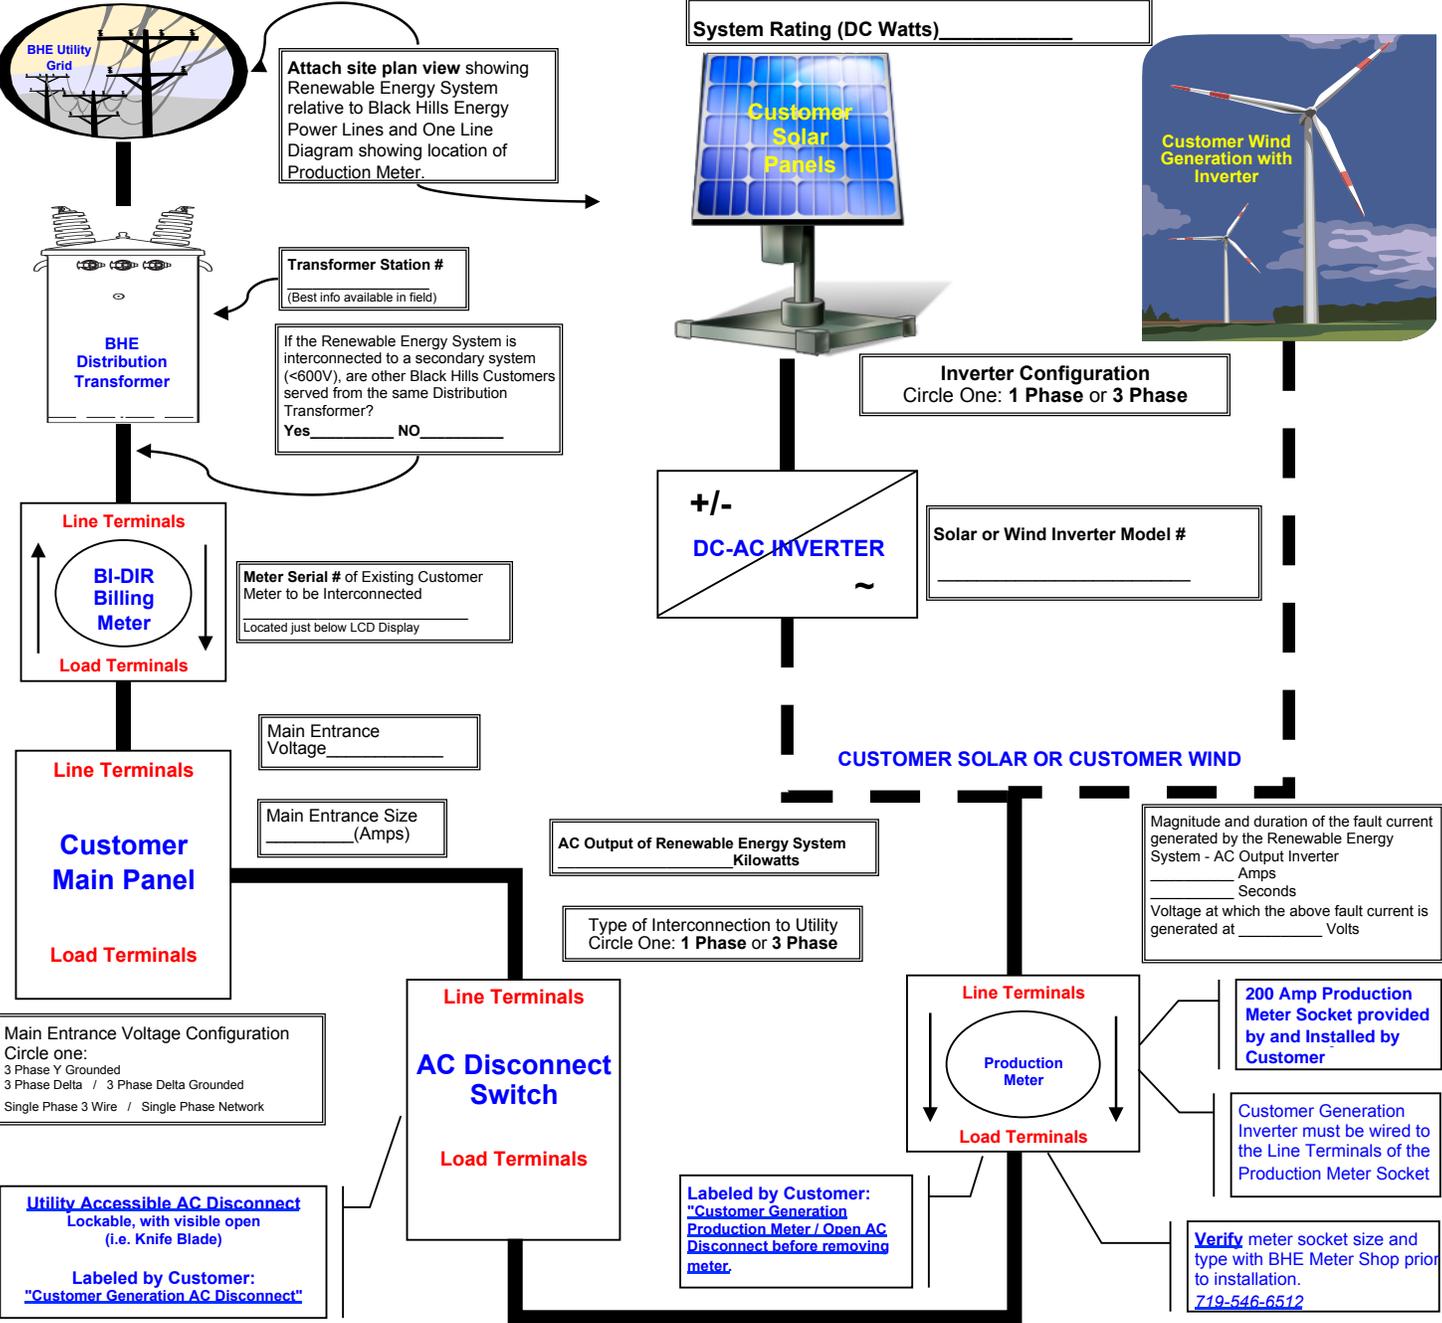

Engineer _____ Phone # _____

Facilities served with 3 Phase conductors shall have a 3 phase inverter connected to Black Hills. 3 Single Phase inverters are **not** an acceptable substitute.

Notes: Complete or provide all information requested in double bordered boxes above, failure to provide all information could result in a rejection of the application. Follow all diagrams and instructions above, failure to do so could result in denial of interconnection permit. Provide one Level 2 document per meter being interconnected.

Black Hills Energy Colorado Electric Typical Hookup Diagram for Interconnection of All Renewable Energy Systems

